


IMS (Intelligent Metering System) Project – Phase.1

Arrangement of kWh Meters in Electric Service Room/Cabinet

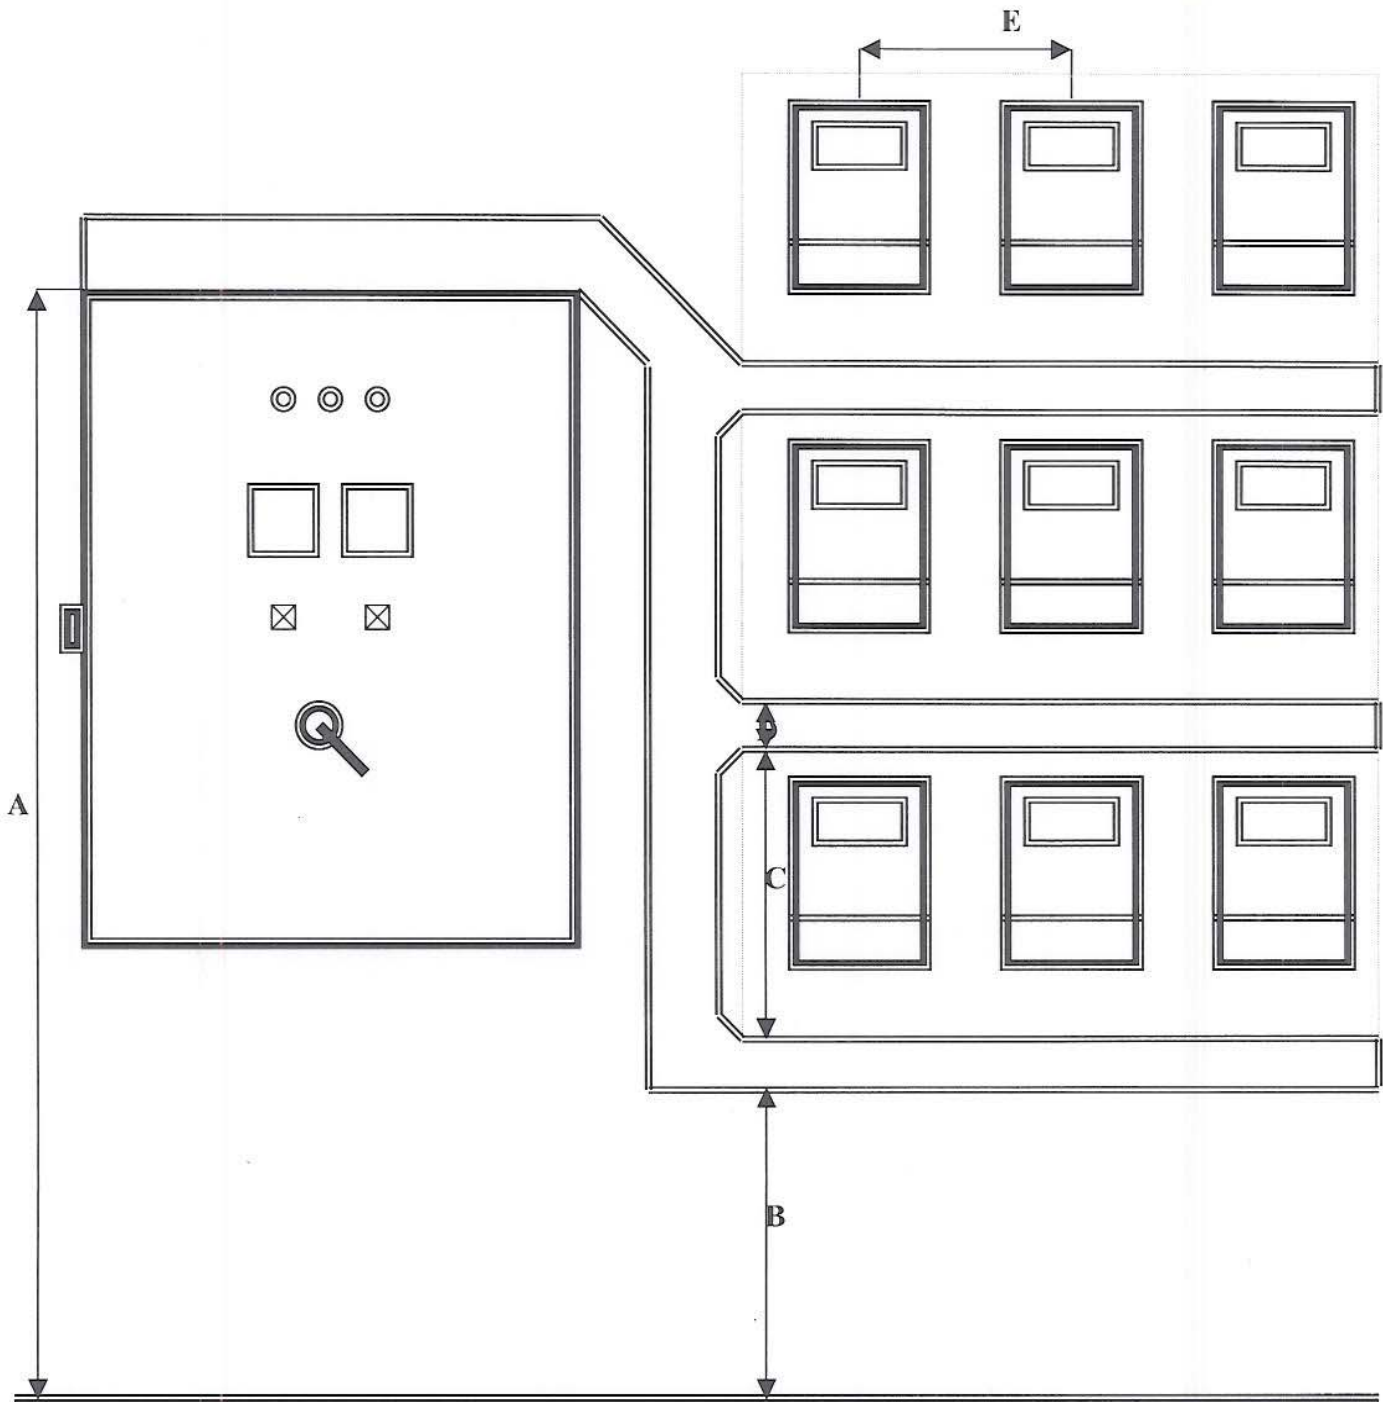

Dimensions in cm

A	B	C	D	E
180 (Max.)	60 (Min.)	50	10	30

Note: Minimum 2 mtr. clearance shall be maintained between electricity and water service cabinets / points.
Refer Annexure: 1, for field requirements.

Shr
1/10